

TITLE: INTELL-LIFT PRO 250 GAL
DOORS - FRONT BACK
28"W x 28"D x 28"H 250 lb. Capacity

REVISIONS

REV	DESCRIPTION	DATE	BY


STOPS: 2 IN-LINE OPP.
OPENINGS: 2 @ LOWER, UPPER.
TRAVEL: I.B.O.

<input checked="" type="checkbox"/> FRONT/BACK	<input checked="" type="checkbox"/> DRYWALL CONSTRUCTION
<input type="checkbox"/> SLIDE-UP	<input type="checkbox"/> MASONRY CONSTRUCTION
<input type="checkbox"/> FLOOR LOADING	<input type="checkbox"/> PLAIN STEEL - PRIMED
<input type="checkbox"/> HOISTWAY DOORS	<input checked="" type="checkbox"/> STAINLESS STEEL - #4
<input type="checkbox"/> FUSIBLE LINK	<input checked="" type="checkbox"/> COUNTER LOADING
<input checked="" type="checkbox"/> 1 1/2 HR U/L "B" LABEL	
<input checked="" type="checkbox"/> EMERGENCY RELEASE	
<input checked="" type="checkbox"/> NON-PLUGGABLE INTERLOCK	

HG-1 SINGLE CONTACT DOOR LOCK & CONTACT NEMA 1
 HG-2 DOUBLE CONTACT INTERLOCK NEMA 1
JAMB MOUNTED 24V PUSHBUTTON STATIONS:
 NON-ILLUMINATED ILLUMINATED
BUTTONS: UP DOWN 1 2 3
LIGHTS: CAR HERE IN USE
 HEADER MOUNTED 24V CAR ARRIVAL LIGHTS

CAR GATE	ALUMINUM	
<input checked="" type="checkbox"/> SLIDE-UP	BY: E11	
ACCESS DOOR	PLAIN STEEL	<input checked="" type="checkbox"/> STAINLESS STEEL - #4
<input checked="" type="checkbox"/> 1 1/2 HR U/L "B"	NONE / BY OTHERS	

HOISTWAY TO BE BUILT BEFORE DUMBWATER IS INSTALLED EXCEPT THE WALLS ARE TO BE OMITTED WHERE HOISTWAY DOORS OCCUR UNTIL THE DUMBWATER IS INSTALLED & HOISTWAY DOORS ARE SET IN PLACE
POWER SUPPLY: A LOCKABLE FUSED DISCONNECT MUST BE PROVIDED IN ACCORDANCE WITH LOCAL ELECTRICAL CODES. THE SUPPLY MUST BE A 115V, 20A DEDICATED CIRCUIT.
DOORS: DOORS MUST MEET LOCAL FIRE CODE. INTERLOCK DEVICES ARE PROVIDED AND MUST BE MOUNTED TO DOORS AS DIRECTED IN THE INSTALLATION GUIDE.

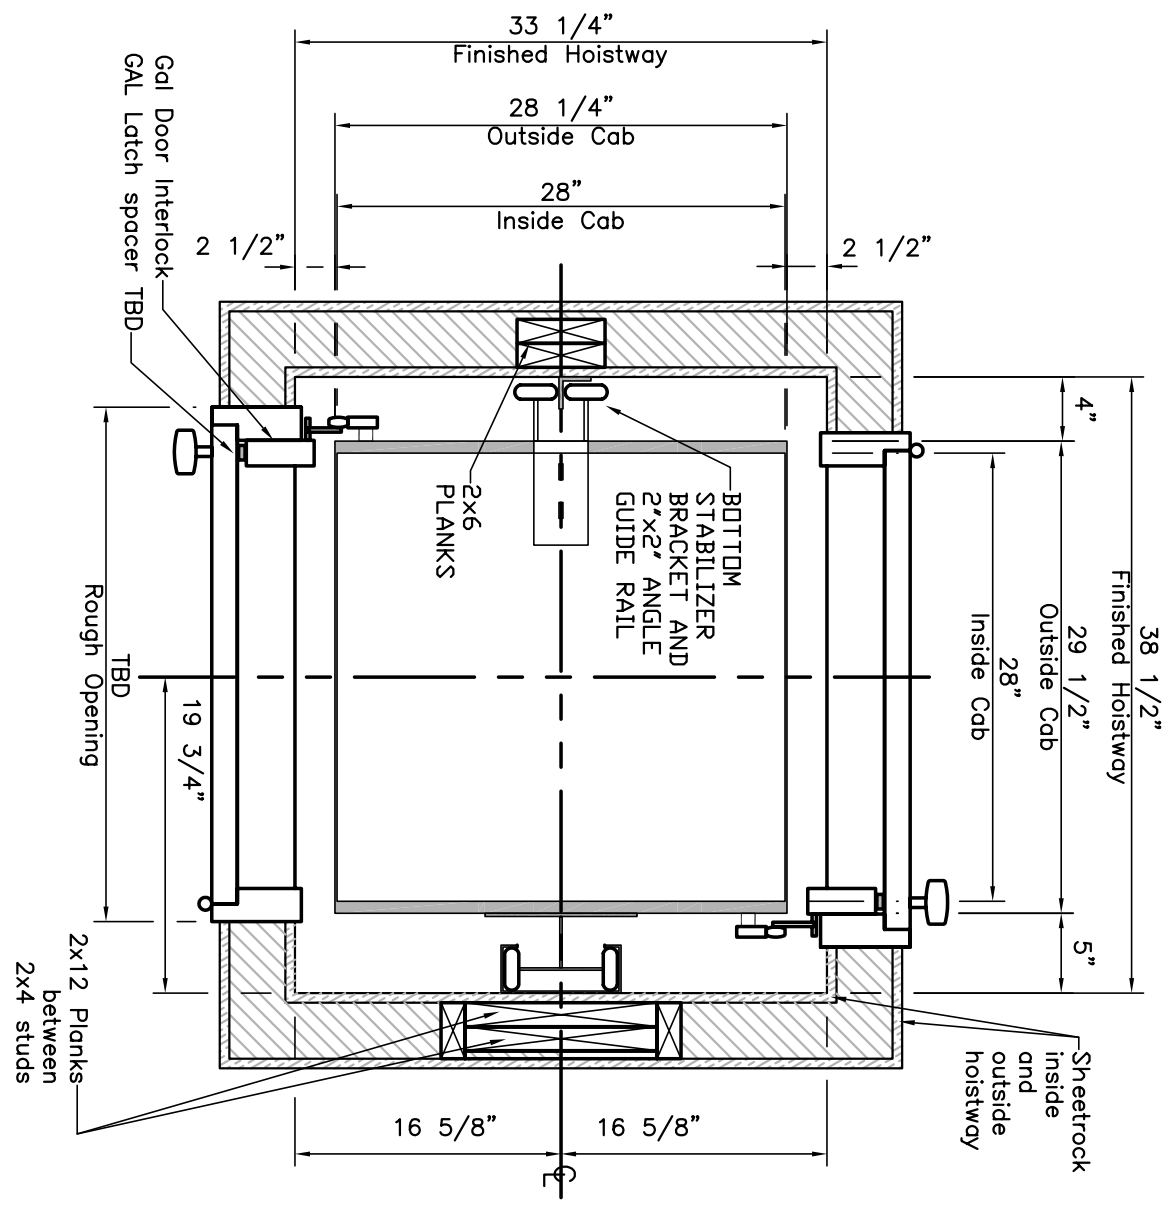


HOISTWAY: THE HOISTWAY MUST BE IN ACCORDANCE WITH "SAFETY CODE FOR ELEVATORS AND ESCALATORS" (ASME A17.1) AND ALL STATE AND LOCAL CODES.

PLUMB HOISTWAY: DUE TO CLOSE RUNNING CLEARANCES OWNER/AGENT MUST ENSURE THAT HOISTWAY IS PLUMB, AND SQUARE AND IS IN ACCORDANCE WITH DIMENSIONS ON THESE DRAWINGS.


REINFORCED WALL: THE RAIL WALL MUST BE REINFORCED WITH DOUBLE 2X12 PLANKS AS SHOWN ON THE DRAWINGS. THE MACHINE AND RAIL SYSTEM REQUIRES THESE 2X12 PLANKS FOR SUPPORT.
MACHINE ROOM: MACHINE ROOM MAY BE LOCATED WITHIN THE HOISTWAY ON THE BOTTOM FLOOR OR IN A CLOSET ADJACENT TO THE HOISTWAY (BEHIND THE RAIL WALL). THE MACHINE ROOM MUST HAVE A LOCKABLE ACCESS DOOR. THIS DOOR MUST REMAINED LOCKED AT ALL TIMES.

CUSTOMER: _____ SHIP TO: _____ APPROVED BY: _____ OPENING: FRONT BACK DWG NO. -----

JOB NAME: _____ DATE APPROVED: _____ SHEET 1 OF 2 DATE: 10/26/09

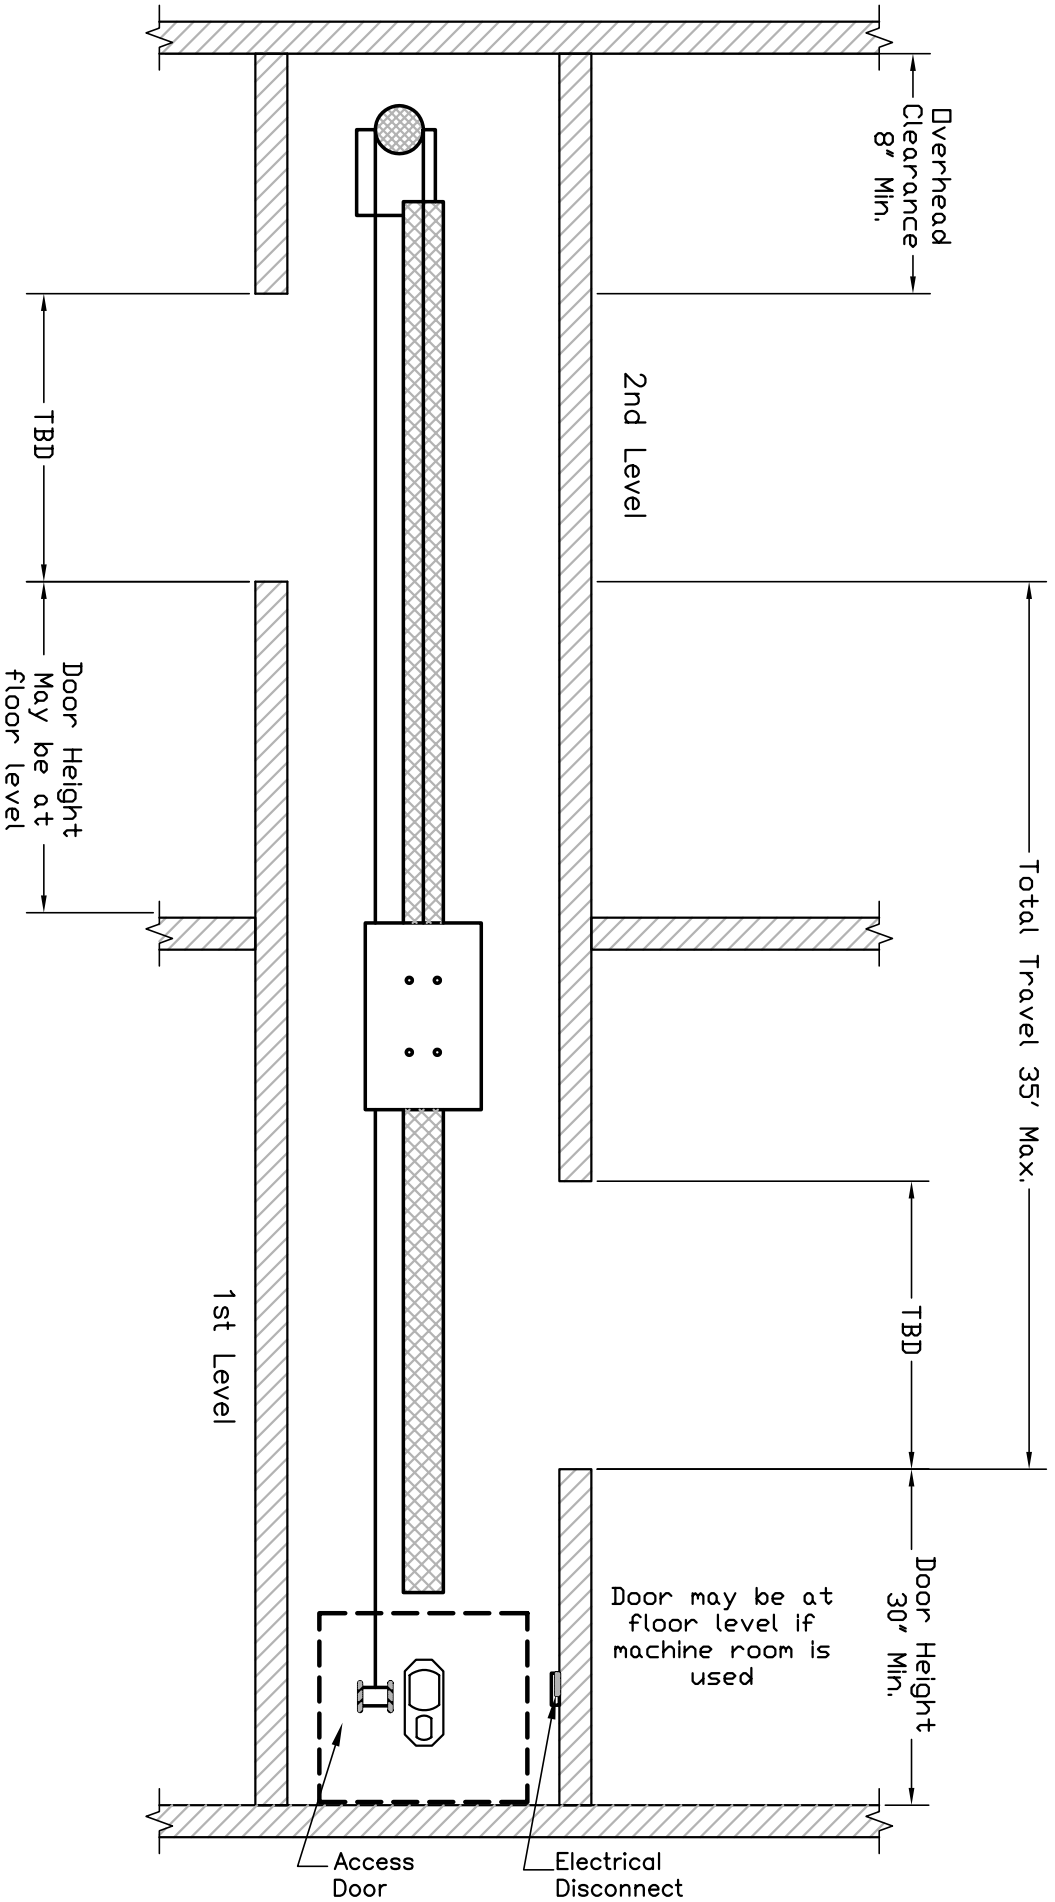

CUSTOMER:	SHIP TO:	APPROVED BY:	TITLE: DUMBWAITER SECTION ELEVATION "A-A"		
JOB NAME:		DATE APPROVED:	OPENING:	SAME SIDE	
			SHEET:	2 OF 2	
			DWG NO.:	-----	
			DATE:	10/21/09	

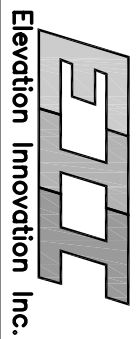

Elevation Innovation Inc.